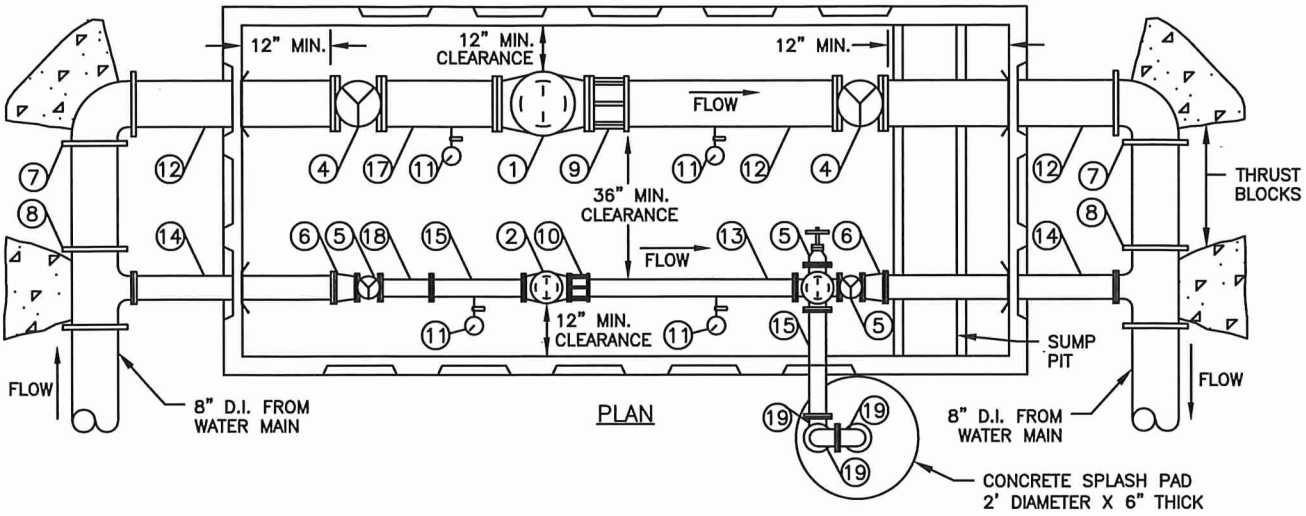

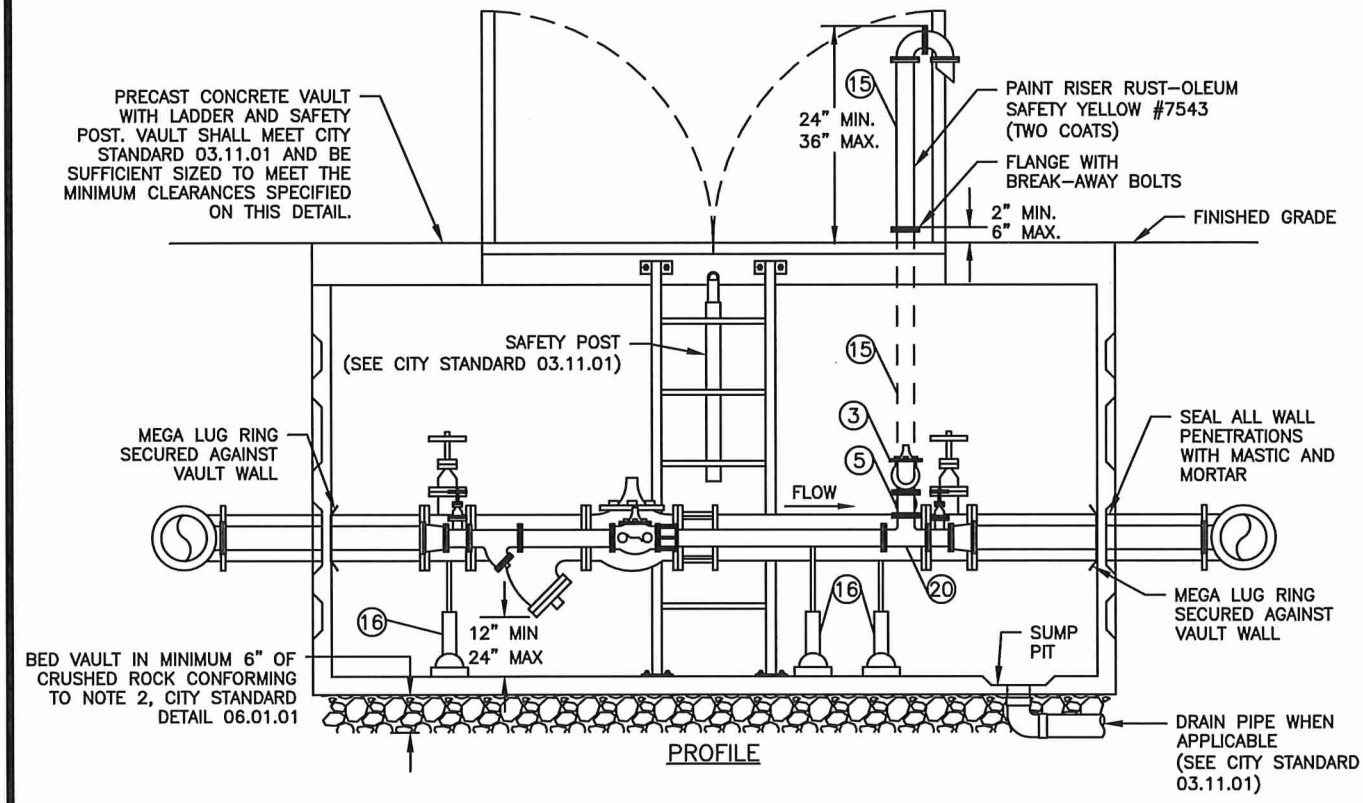

CONSTRUCTION NOTES

1. 8" CLA-VAL 90G-01AB – CLASS 150 PRESSURE REDUCING VALVE
2. 3" CLA-VAL 90G-01AS – CLASS 150 PRESSURE REDUCING VALVE
3. 3" CLA-VAL 50A-01B – CLASS 150 VERTICAL HIGH PRESSURE RELEASE VALVE
4. 8" FLANGED HAND WHEEL GATE VALVE (2 REQUIRED)
5. 3" FLANGED HAND WHEEL GATE VALVE (3 REQUIRED)
6. 4"x3" (FLxFL) REDUCER (2 REQUIRED)
7. 8" 90° MECHANICAL JOINT ELL (2 REQUIRED) (MEGALUG)
8. 8"x4" (MJxMJxFL) TEE (2 REQUIRED) (MEGALUG)
9. 8" FLANGE COUPLING ADAPTOR
10. 3" FLANGE COUPLING ADAPTOR
11. OIL FILLED PRESSURE GAUGE WITH SHUT-OFF VALVE PETCOCK W/DRAIN (4 REQUIRED)
12. 8" (FLxPE) SPOOL (LENGTH AS REQUIRED)
13. 3" (FLxPE) SPOOL (LEGNTH AS REQUIRED)
14. 4" (FLxFL) SPOOL (LENGTH AS REQUIRED)
15. 3" (FLxFL) SPOOL (LENGTH AS REQUIRED)
16. PIPE SUPPORTS (3 REQUIRED)
17. 8" FLANGED WYE STRAINER
18. 3" FLANGED WYE STRAINER
19. 3" FLANGED 90° ELL (3 REQUIRED)
20. 3" FLANGED TEE

CITY OF PUYALLUP
OFFICE of THE CITY ENGINEER

APPROVED FOR PUBLICATION
HANS P. HUNGER STATE OF WASHINGTON 03750 REGISTERED PROFESSIONAL ENGINEER
DATE SEALED: 11/17/2020

PRESSURE REDUCING STATION

(NOT TO SCALE)

CITY STANDARD 03.09.01

FILE NAME: Y:\SHARED\DRAWINGS CITY STANDARDS\2018\02 - PART 2 - STANDARD DETAILS CAD\300\03.09